

INSTALLATION, OPERATION, AND MAINTENANCE MANUAL

This publication contains the installation, operation and maintenance procedures for standard units of the **R Series - Inline Fans**

Carefully read this publication prior to installation.

Receiving and Inspection

Carefully inspect the fan and accessories for any damage or shortage upon receiving the fan.

- Turn the wheel by hand to ensure it turns freely and does not bind.
- Inspect dampers (if included) for free operation of all moving parts.
- Remove shipping tape.
- Record on the *Delivery Receipt* any visible sign of damage.

Storage

If the fan is stored for any length of time prior to installation, store it in its original shipping crate and protect it from dust, debris and weather.

WARNING

This unit has rotating parts. Safety precautions should be exercised at all times during installation, operation, and maintenance.

ALWAYS disconnect power prior to working on fan.

PERSONAL SAFETY

Disconnect switches are recommended. Place the disconnect switch near the fan so that the power can be swiftly cut off in case of an emergency, and so that maintenance personnel are provided complete control of the power.

READ AND SAVE THESE INSTRUCTIONS



*On select Models



Electrical Supply

Check that the voltage and circuit details on the fan are suitable for your supply.

Caution: Never work on a fan unless power is turned off.

Wiring

All wiring should be carried out in compliance with regulations for electrical installations and comply with any local requirements.

Caution: Never work on a fan unless power is turned off.

Starting

All fans are suitable for direct starting by switch or direct line starter. All fans may be directly controlled by thermostat or similar devices, provided that the current rating is at least three times the motor rating.

Protection

All fan blowers are provided with Thermal Overload Protection internally. In the event that the fan overheats, the T.O.P. will break the circuit until the fan returns to normal operating temperature.

Caution: Never work on a fan unless power is turned off.

Rotating

The direction of rotation, looking into the hub of the blower, is clockwise.

Mounting (See images to the right)


All fans are suitable for mounting in any plane. Attach the black plastic mounting bracket to the support frame where you wish to mount the fan. Slide in the metal bracket (attached to the fan) into the already mounted black plastic bracket until you hear a light clicking sound.


Operation

All fans are suitable for internal or external use. When used externally, sealing around the casing joint is recommended. The blower is designed to operate in a temperature range of -25F to +175F and up to 95% Relative Humidity.

Ductwork Connection

Flexible ducting should be clamped to the unit by using screw tensioned connector clips or duct tape. Rigid ducting should be connected with a flexible connector and screw tensioned clip or insulated fast clamp.

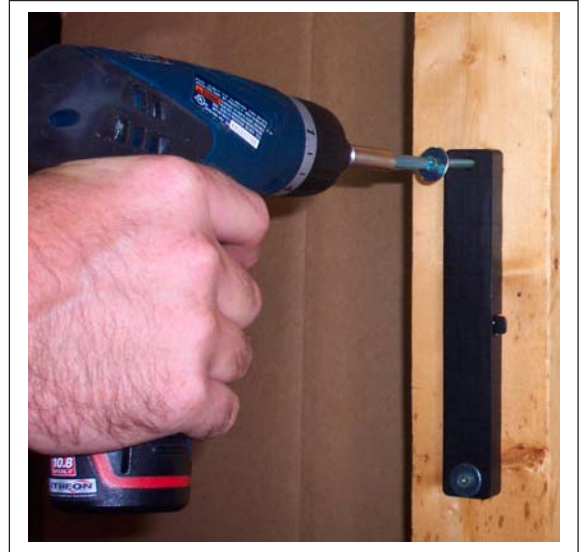

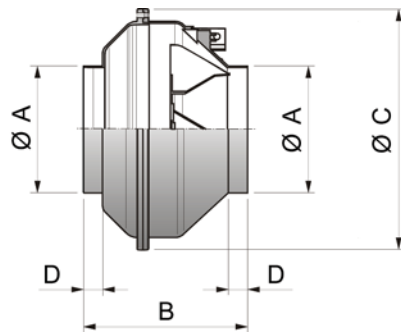


| Model | A | B | C | D |
|--------|----|------|------|-----|
| *R-100 | 4 | 9.7 | 11.3 | 1.2 |
| R-110 | 4 | 9.7 | 11.3 | 1.2 |
| R-125 | 5 | 9.7 | 11.3 | 1.2 |
| *R-150 | 6 | 9.0 | 14.9 | 1.2 |
| *R-200 | 8 | 9.0 | 14.9 | 1.2 |
| R-225 | 8 | 9.0 | 14.9 | 1.2 |
| R-250 | 10 | 9.0 | 14.9 | 1.2 |
| *R-315 | 12 | 10.8 | 17.8 | 1.2 |

All dimensions in inches
* Energy Star


Wiring Diagrams

Models: R Series

ALL MODELS

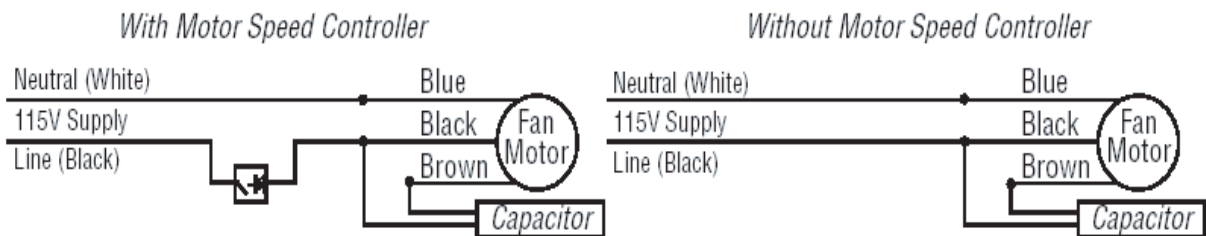

MULTIPLE LOCATION SWITCHING WIRING DIAGRAM

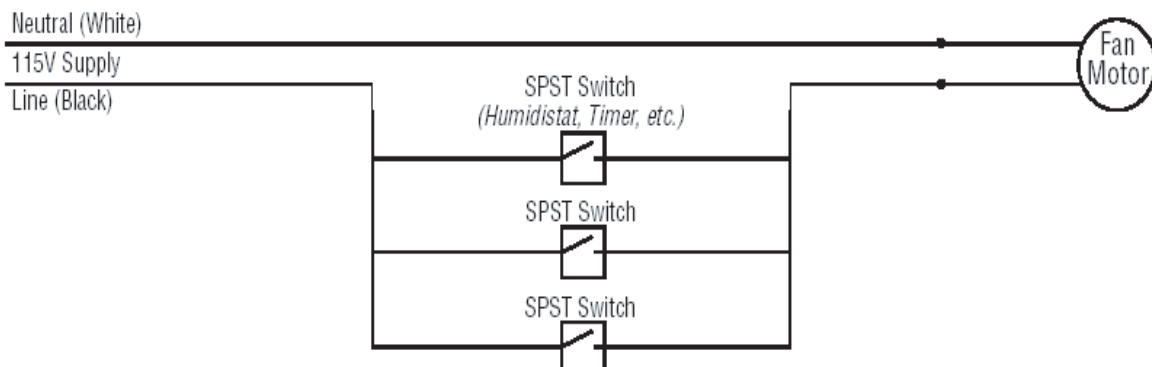

Models: R Series

SPECIAL WIRING PRECAUTIONS

All installations should be wired according to the supplied diagrams. Failure to comply will cause the motor to "hum" or not work.

1. Turn off power at service entrance before wiring this fan.
2. Read the fan serial number to determine the current draw. Check that available supply is suitable.
3. Be certain to use proper connector type for securing conduit cable.
4. Connect electrical supply per diagrams supplied.

Troubleshooting

1. If fan fails to operate, please check the following:
 - a) Consult wiring diagrams included to assure proper connection.
 - b) To assure proper contact, check motor lead wiring, incoming supply wiring and capacitor connections.
 - c) If possible, use a meter to test for continuity between fan leads. Please note that capacitor will show no reading if tested with meter.
2. If fan still fails to operate, consult distributor for return/replacement instructions.

Maintenance

1. Since fan bearings are sealed and have been provided with an internal lubricating material, no lubrication is necessary.
2. At least once a year, clean any particles accumulated in the fan.
3. When using in a dryer boosting application, **DISCONNECT POWER SUPPLY** and check impeller periodically or any lint build up. No other maintenance is necessary.

Limitation of Warranty and Liability

This warranty does not apply to any product or part which has failed as a result of faulty installation or abuse, incorrect electrical connections or alterations made by others, or use under abnormal operating conditions or misapplication of the products or parts. Directfans.com will not approve for payment any repairs not made by us or our authorized agent without prior written consent. The foregoing shall constitute our sole and exclusive warranty and our sole and exclusive liability, and is in lieu of all other warranties, whether written, oral, implied or statutory. There are no warranties which extend beyond the description on the page hereof. Directfans.com does not warrant that said goods and articles are of merchantable quality nor that they are fit for a particular purpose. Our liability on any claim of any kind, including negligence, for any loss or damage arising from or connected with, or resulting from, the sale and purchase of the products and parts covered by this proposal, acknowledgement, order or from the performance or breach of any contract pertaining to such sale of purchase, or from the design, manufacture, sale, delivery, resale, installation, technical direction in installation, inspection, repair, operation or use of any product or part covered by the proposal, acknowledgement, order or furnished by Directfans.com shall, in no case, exceed the price allocable to the products or parts thereof which give rise to the claim and shall terminate at the end of the applicable warranty period of said product or part. In no event whether as a result of breach of contract, or warranty or alleged negligence, defect, incorrect advice or other causes, shall be liable for special or consequential damages, including but not limited to loss of profits or revenue, loss of use of equipment or any associated equipment, cost of capital, cost of substitute equipment, facilities or services, downtime cost, or claims of customers of purchases for such damages. Directfans.com neither assumes nor authorizes any person to assume for it any other liability in connection with the sale of its products or parts. Some jurisdiction do not allow the exclusion or limitation of incidental or consequential damages, so the above limitations and exclusions may not apply to you

LIMITED WARRANTY

Directfans.com warrants its products and parts to be free from defects in workmanship and service for period of one (1) year from the date of purchase. Products and parts not specifically designed for use in a corrosive or explosive environment shall have no warranty and the user assumes full liability for use in such environments. Our obligation under this warranty is limited to the repair or replacement as our option, without cost at our facility, of any part or parts thereof which shall, within the warranty period, be returned to us with transportation charges prepaid, and which our examination discloses as being defective. All requests for repair or replacement must be directed to Directfans.com for authorization prior to the return of any product or part. This warranty gives you specific legal rights and you may also have other rights in the jurisdiction in which you reside. (It is incumbent upon the claimant to provide substantiation of purchase of installation dates if such question should arise.)

DISCLAIMER

Directfans.com has made a diligent effort to illustrate and describe the products in this literature accurately however, such illustrations and descriptions are for the sole purpose of identification, and do not express or imply a warranty that the products are merchantable, or fit for a particular purpose, or that the products will necessarily conform to the illustrations.

Supply and Exhaust Grill


These all new unique grills/diffusers are designed to be cosmetically appealing, easy to install, removable, adjustable, stainless steel spring clips for positive fixture, and of course quiet.

Better still, one grill may be used for supply and exhaust applications. The combination is what makes the Quiet Grill a desirable alternative to typical exhaust grills and supply air diffusers.

Each grill/diffuser is manufactured of high quality flame retardant, first grade polypropylene plastic that will not discolour over time. Full peripheral 1 1/4 x 3/8 foam gasket to ensure ceiling mate.


They are ideal for damp environments, and unlike metal alternatives, will not rust.

As capital as one can see the Quiet Grill concept offers many advantages over typical alternatives and provides cosmetic appeal, practicality and non-restrictive air performance.

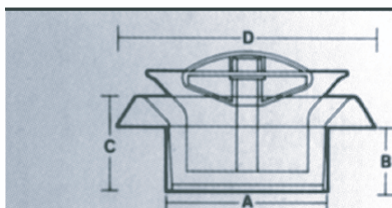

| Model | A | B | C | D |
|-------|------------------|----------------|----------------|------------------|
| HG45 | 3 9/16" (90mm) | 2 5/16" (58mm) | 3 1/16" (78mm) | 6 1/4" (159mm) |
| HG56 | 4 11/16" (118mm) | 2 1/2" (64mm) | 3 1/4" (83mm) | 7 13/16" (195mm) |

Four Pre-Set Settings

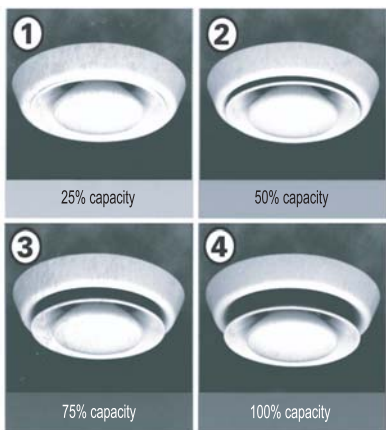

How to use performance chart

First a calculation must be made to establish how much airflow (cfm) is needed for the job.

Then the chart can be used to calculate how much static pressure (resistance) is being created by the grill.

Accessories

-White polymeric collar for flex duct connection

Installation as easy as 1,2,3



Can be installed directly into duct.